


NOTE:
1. All joints to be restrained,
Glend (mega-lug) or equiv.
2. All joints to be stainless steel
3. A tracing wire shall be installed
and brought above grade. (12 gauge,
solid strand, insulated wire
4. Sacrificial zinc anode nuts are
to be installed on all bolts.
5. Ports should face roadway unless
specified otherwise by Resident
Engineer

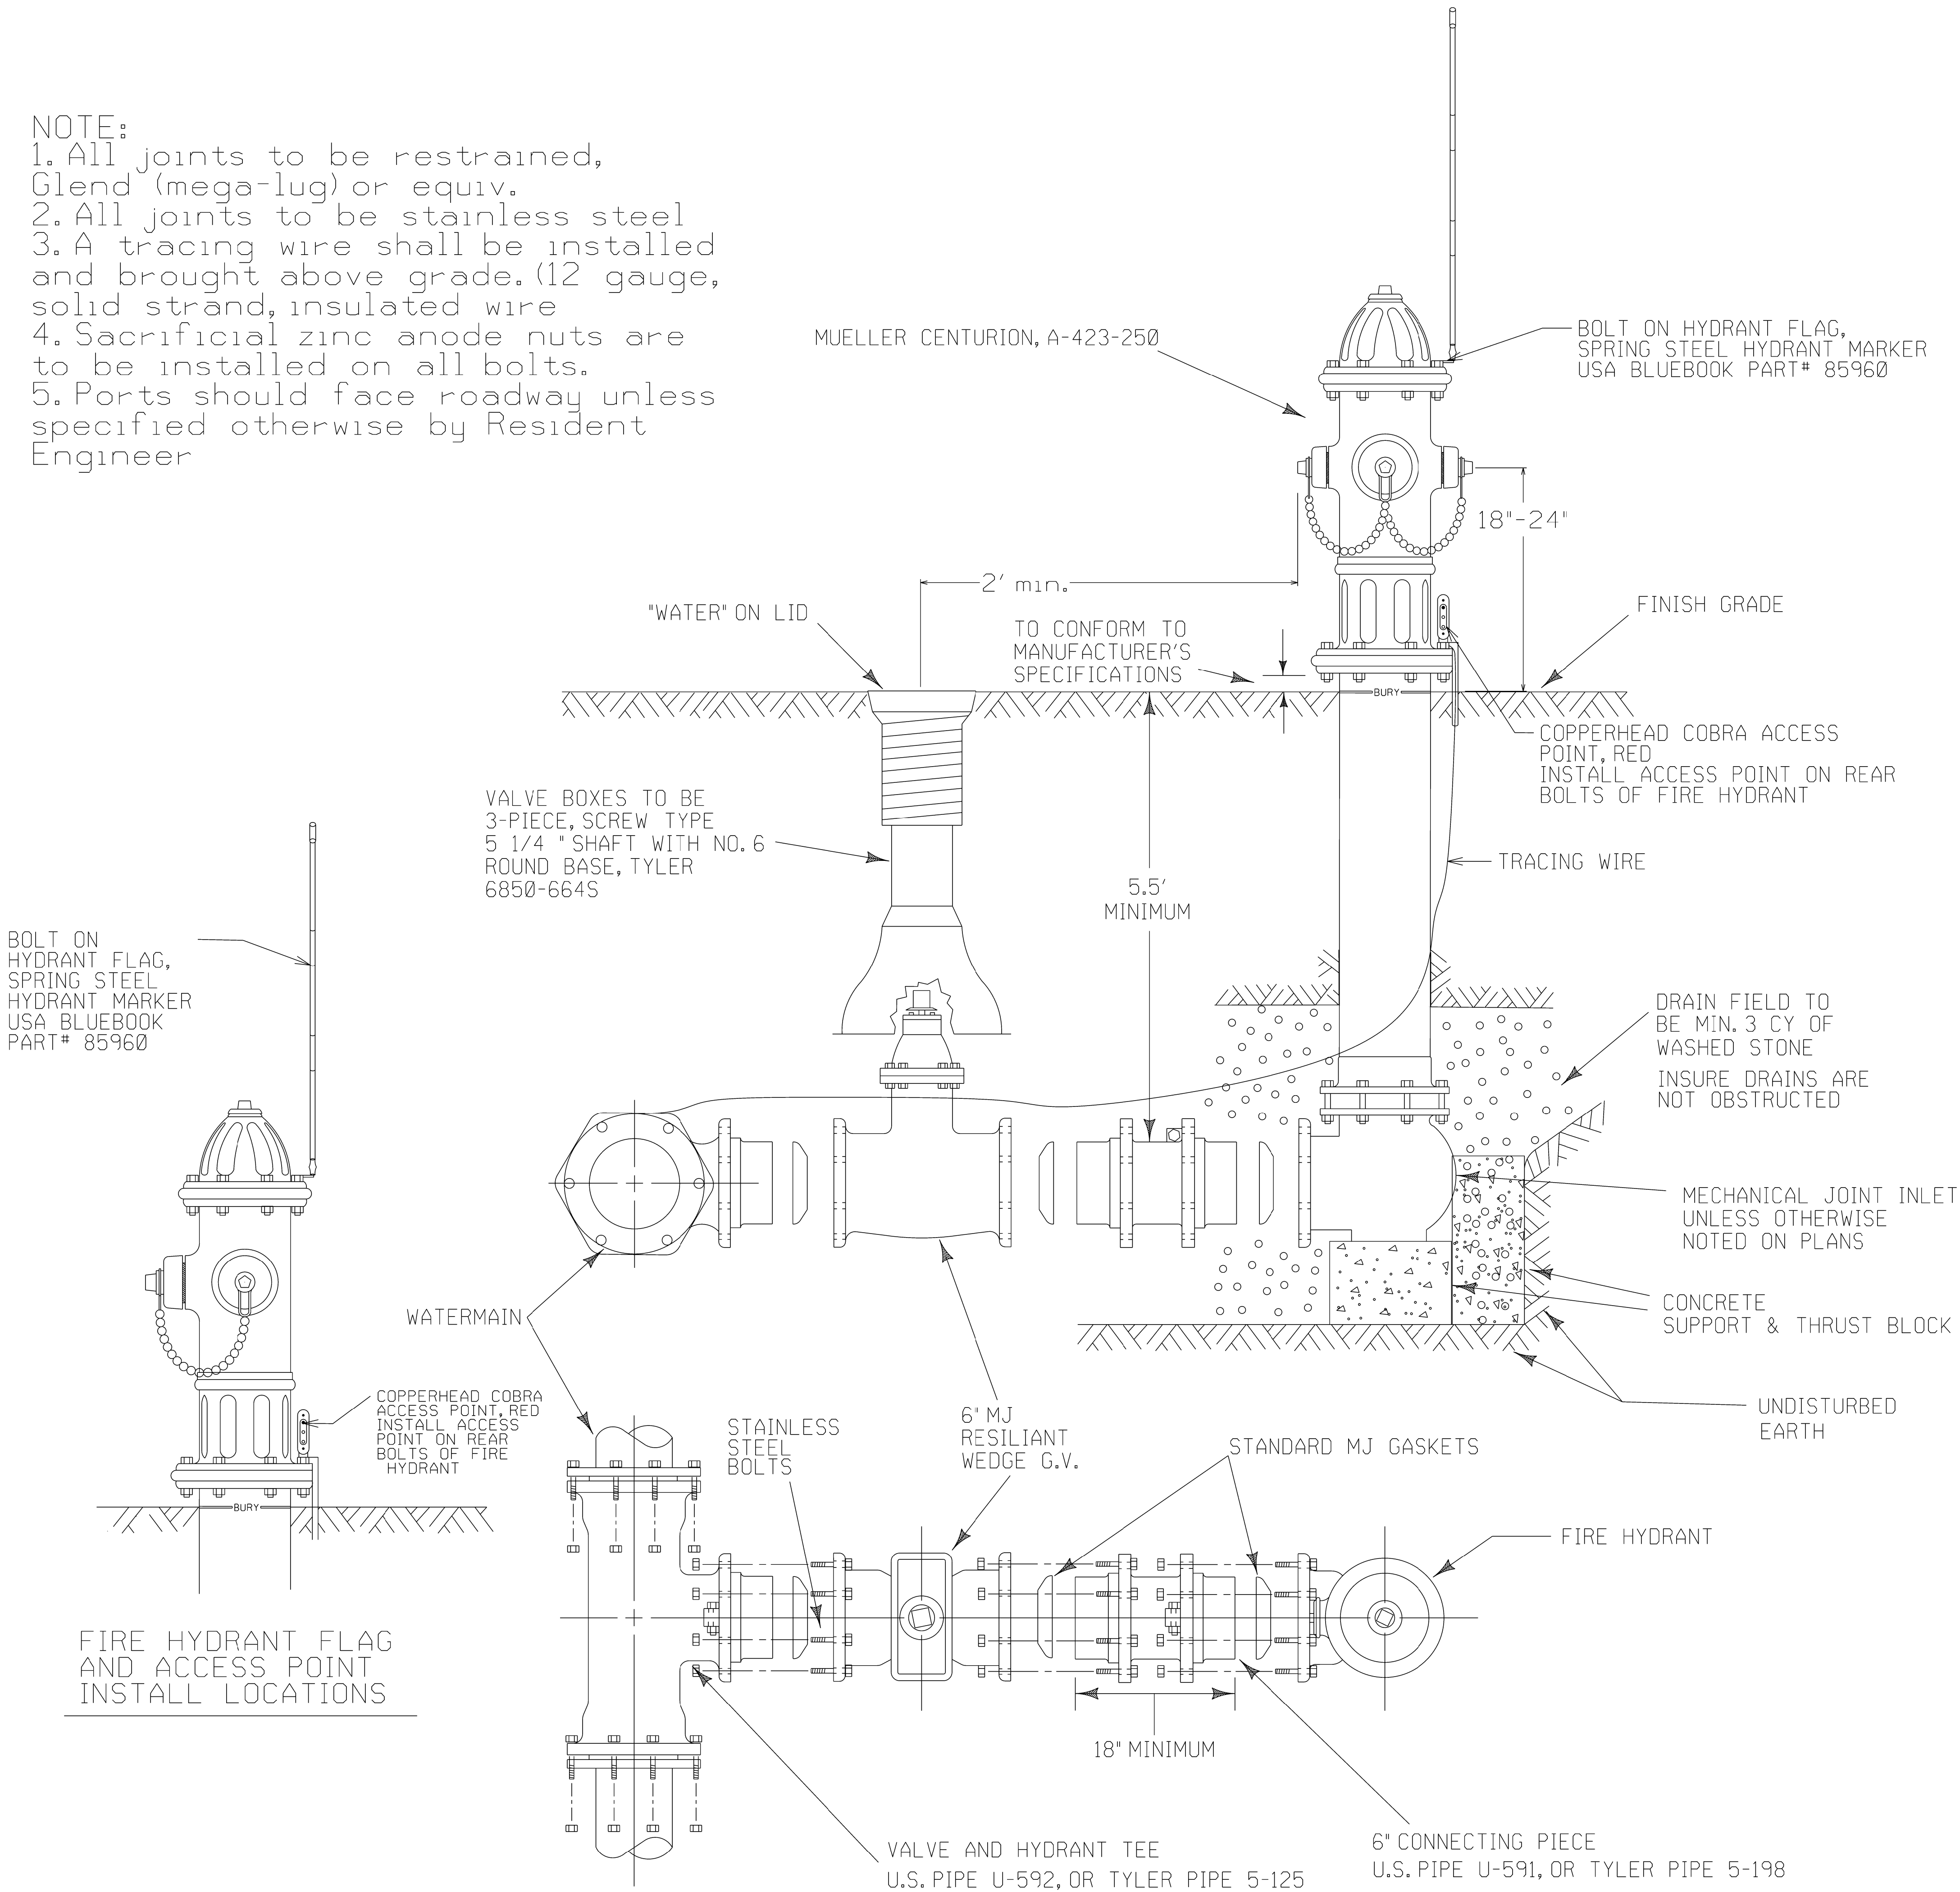

TYPICAL HYDRANT INSTALLATION

Issued		
By	Revised	Date
MAD		7-28-11
MJ		6-24-14
JB		1-05-23
DS		1-26-23
DS		10-28-25

VILLAGE OF GURNEE
ENGINEERING DIVISION

Approved by:	
SD	1/4/06
SD	7/29/11
SD	6/24/14
NL	1/26/23
NL	10/31/25