


(Max.) Trench Widths - 9" + O.D. + 9", When trench is Less than 5' Deep
- 18" + O.D. + 18", When trench is Greater Than 5' Deep

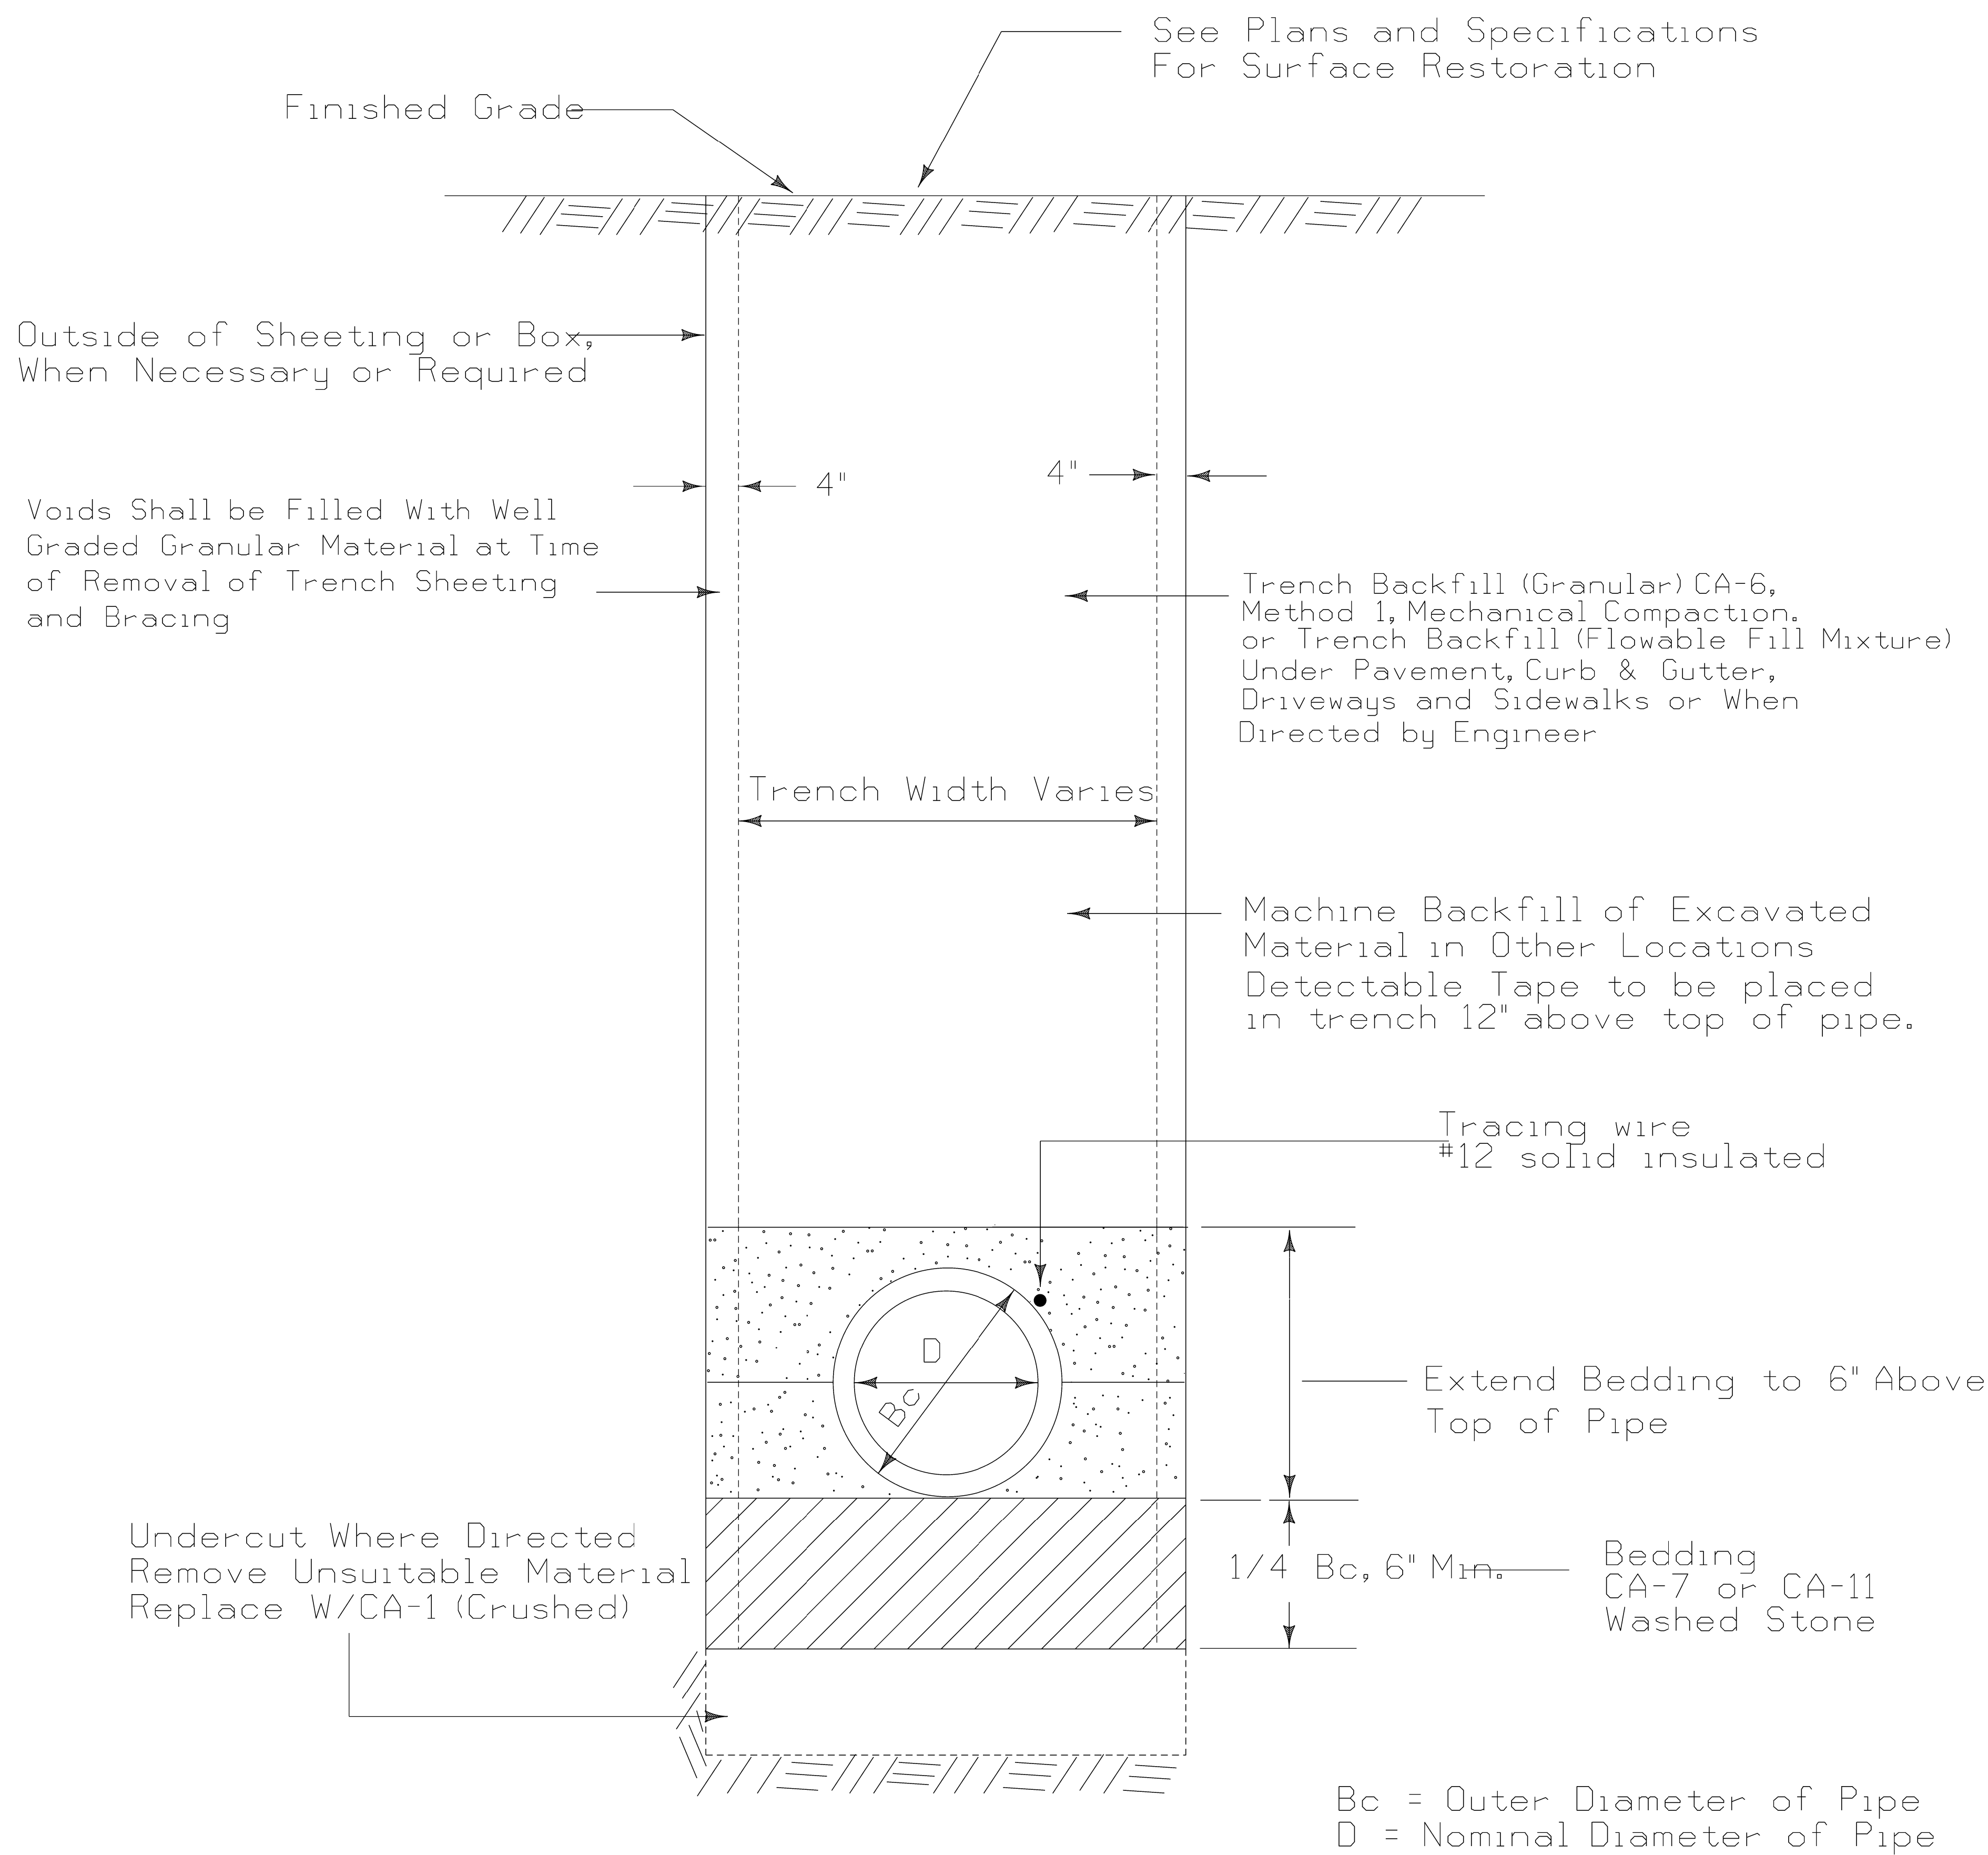

NOTES:

1. Restrained Joint (Megalog) or equivalent required on all fittings.
2. Sacrificial zinc anode nuts are to be installed on all bolts.

TYPICAL TRENCH AND BEDDING DETAIL
WATER MAIN INSTALLATION

Issued		
By	Revised	Date
DPD		3/17/03
MAD		7/28/11
MJ		6/25/14
DS		10/29/25

VILLAGE OF GURNEE
ENGINEERING DIVISION

Approved by:	
SD	1/4/06
SD	7/29/11
NL	10/31/25